




*Life Safety
Made Simple*

Annual Fire Sprinkler Inspection NFPA 25 5.2

- Sales
- Estimating
- Design
- Installation
- Inspections
- 24 Hour Emergency Service & Repair
- Fire Alarm
- Monitoring
- Security
- Fire Sprinkler & Suppression Systems

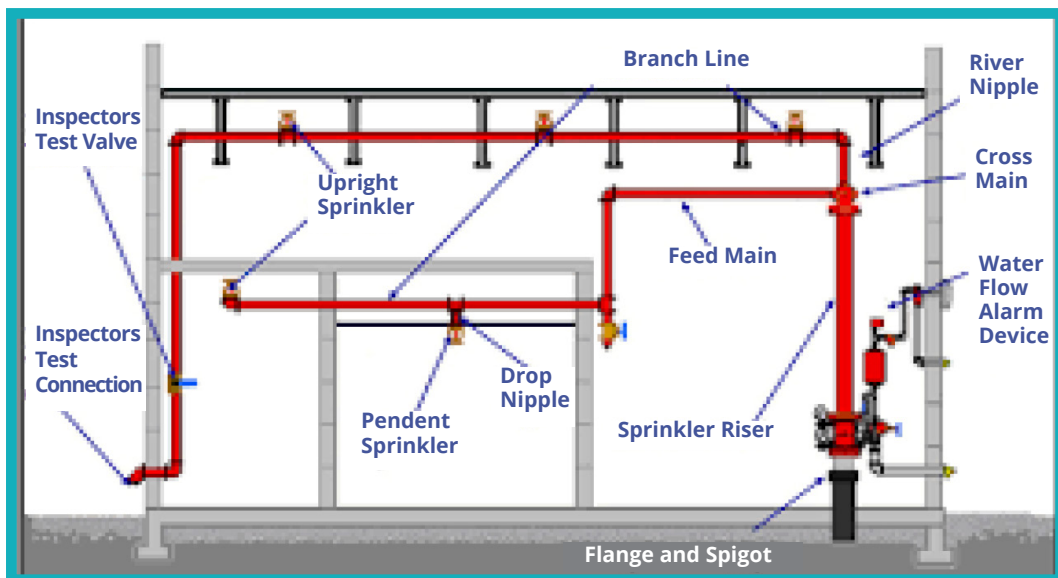

Pipe Hanger

A requirement of NFPA 25, 14.2 (the standard for fire sprinkler inspections) is that every year you are also required to have a licensed contractor conduct an annual inspection of your fire sprinkler system.

This test inspection covers the following:

- Sprinklers will be inspected from the floor level for proper coverage and condition.
- Sprinkler Pipe, Fittings, Hangers, Braces and Supports will be inspected from the floor level for condition.
- Hydraulic Design Information shall be inspected to verify that it is provided, attached to the riser and is legible.
- All Water Flow and Water Control Devices and Valves will be tested.
- Anti-Freeze System Solutions (where applicable) Shall be tested.

Brothers Fire & Security can provide you all necessary labor and materials to perform this inspection for you. Contact one of our sales reps today!